


Strut Clamp – ZSCU

Universal Strut Clamp

Standard finish is Electro-Galvanized (EG).

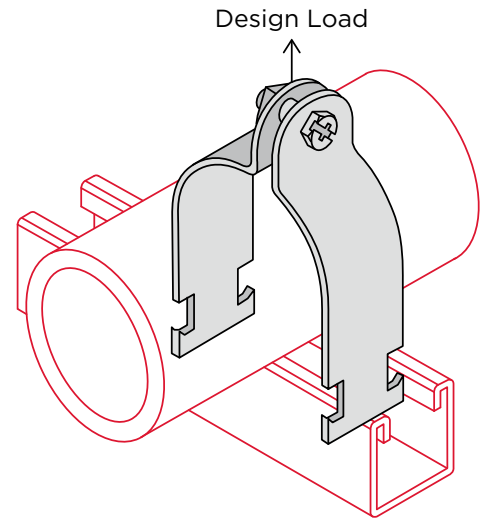

CATALOG NUMBER	CLAMP SIZE		OD				DESIGN LOAD		WEIGHT
	in.	mm	Minimum (in.)	Minimum (mm)	Maximum (in.)	Maximum (mm)	lbs.	kN	lbs.
ZSCU0050EG	½	15	0.706	17.93	0.840	21.34	400	1.78	0.10
ZSCU0075EG	¾	20	0.922	23.42	1.050	26.67	600	2.67	0.13
ZSCU0100EG	1	25	1.163	29.54	1.315	33.40	600	2.67	0.15
ZSCU0125EG	1¼	32	1.510	38.35	1.660	42.16	600	2.67	0.17
ZSCU0150EG	1½	40	1.740	44.20	1.900	48.26	800	3.56	0.29
ZSCU0200EG	2	50	2.197	55.80	2.375	60.32	800	3.56	0.34

*These clamps are designed to fit both pipe (rigid conduit) and thin walled tubing (EMT) in the corresponding sizes.

Material Specifications and Finishes

Carbon Steel – ASTM A1011-00 SS GR 33 or ASTM A1011-00CS Type B

EG – Electro-Galvanized. Electroplating deposits zinc on the surface of the steel by electrolysis from a bath of zinc salts. Recommended for relatively dry indoor use. This is the standard coating for most ZI-Strut products. Thickness of applied zinc is between 0.2 mils and 0.5 mils (5.1 µm to 12.7 µm). Coatings on ZI-Strut EG products meet ASTM B633 SC1 Type III.

HD – Hot Dip Galvanized After Fabrication. Fabricated product is dipped in molten zinc and is completely covered on all surfaces. Recommended for outdoor use. Coatings on ZI-Strut HD products meet ASTM A123/153. The zinc coating is typically 2.6 mils (66.0 µm) or 1.5 oz. per square foot (0.46 kg per square meter) per side.

PV – PVC Coated

S4 – 304 Stainless Steel – ASTM A240 (Type 304)

S6 – 316 Stainless Steel – ASTM A240 (Type 316)
316 Stainless Steel Nuts – ASTM A276-03

YC – Yellow Zinc Dichromate. A 0.5 mil (12.7 µm) electro-galvanized zinc plating meeting ASTM B633 SC1 Type III is applied to the surface of the metal. Yellow Dichromate is applied over the zinc. This results in a yellowish gold appearance and acts as a nonporous barrier sealant that is corrosion resistant and can be painted.

Note: Specifications subject to change without notice.

SUBMITTAL INFORMATION

PROJECT: _____ CONTRACTOR: _____ DATE: _____

ENGINEER: _____ SPECIFICATION REFERENCE: _____ SYSTEM TYPE: _____

LOCATIONS: _____ COMMENTS: _____

ZI-112823